



NOTE: COREDRILL DUCT SIZE, DO NOT CUT REINFORCEMENT BARS OF THE EXISTING ROOF SLAB.


DUCT PENETRATION THRU ROOF (NOT TO SCALE)

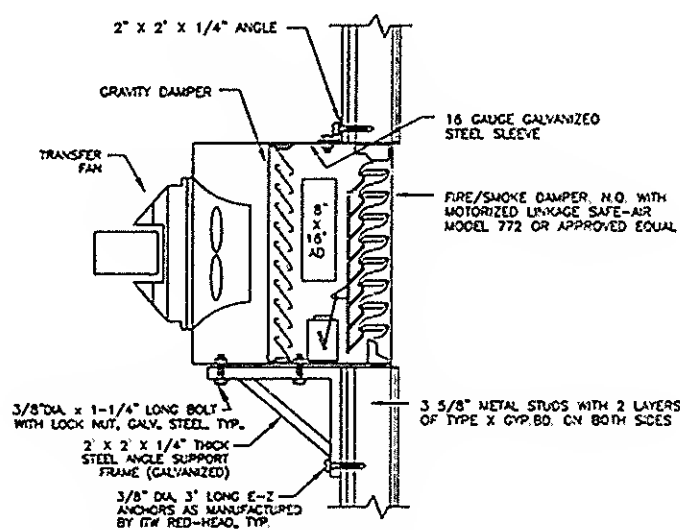

TRANSFER FAN DETAIL (NOT TO SCALE)

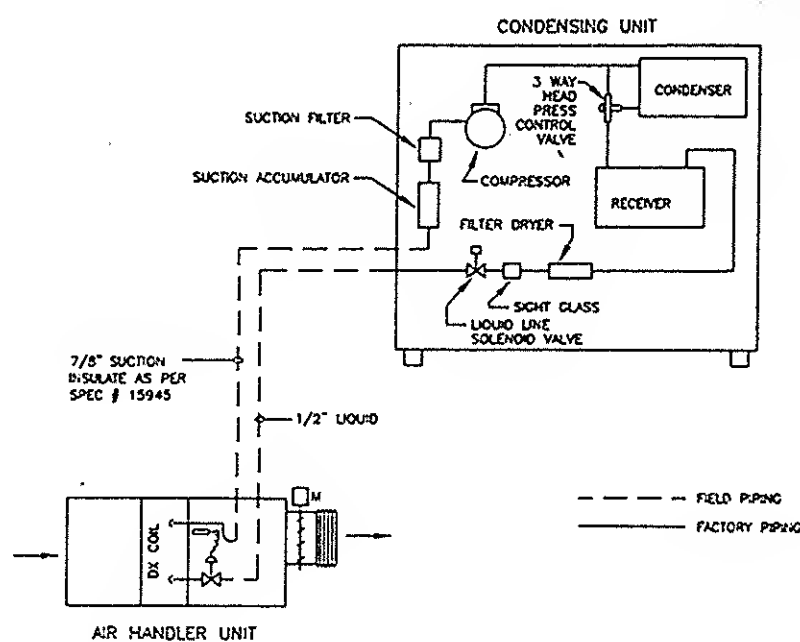


AC-1 UNIT: REFRIGERANT PIPING SCHEMATIC

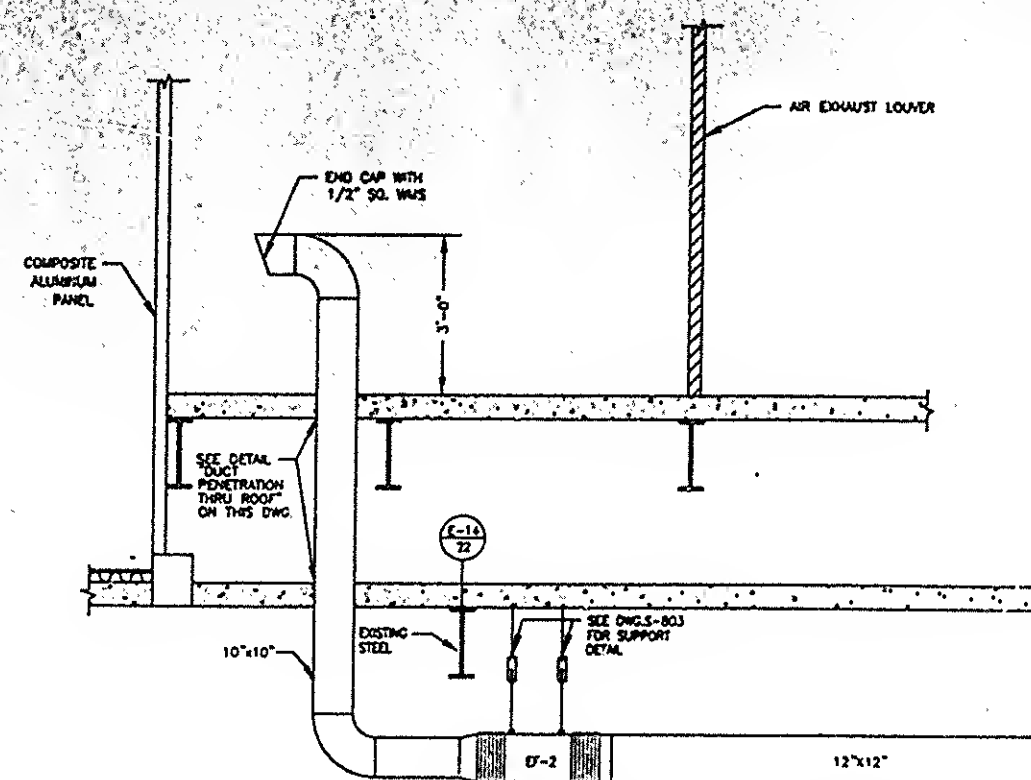


SCALE IN FEET

SECTION

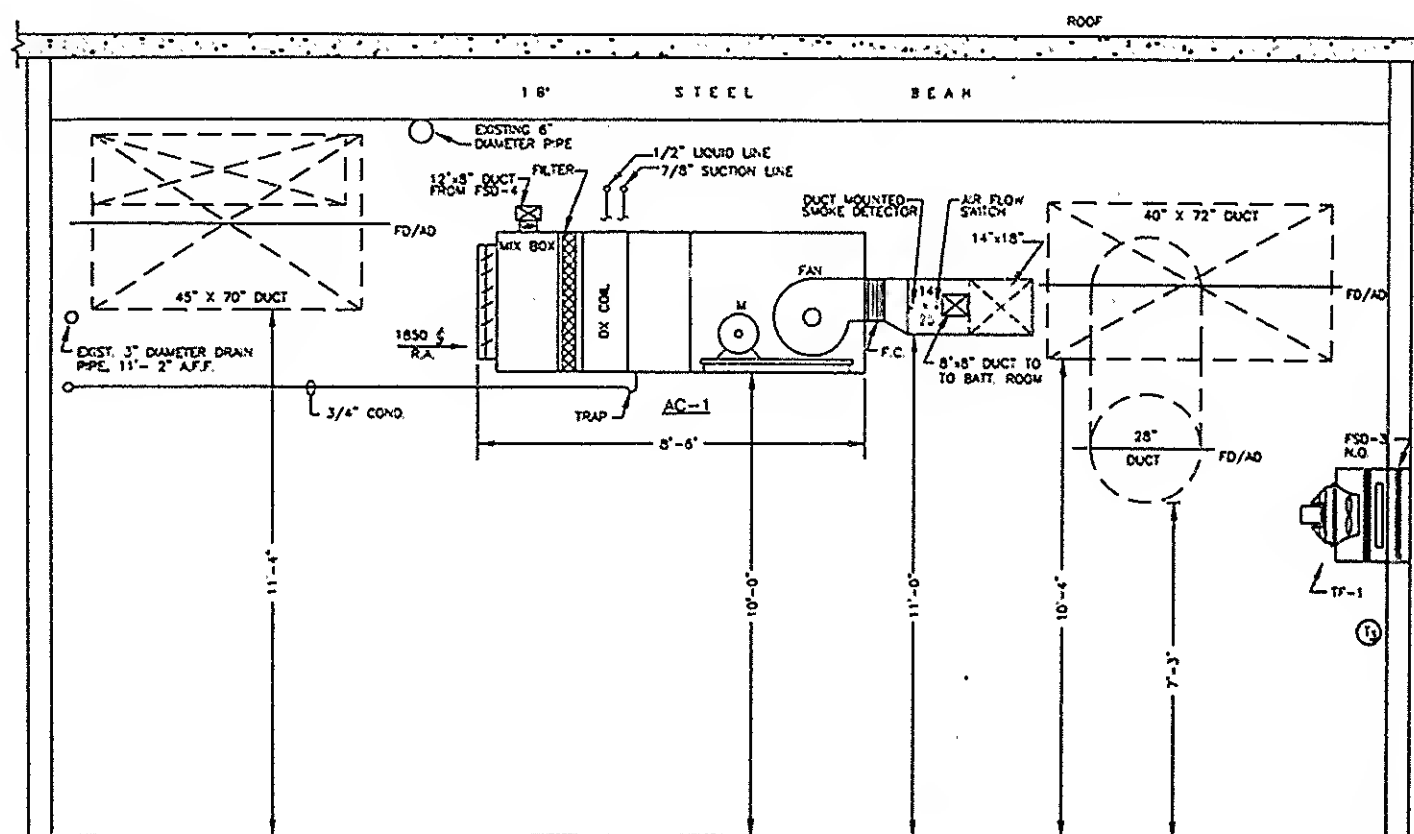

SCALE IN FEET

SECTION A - A

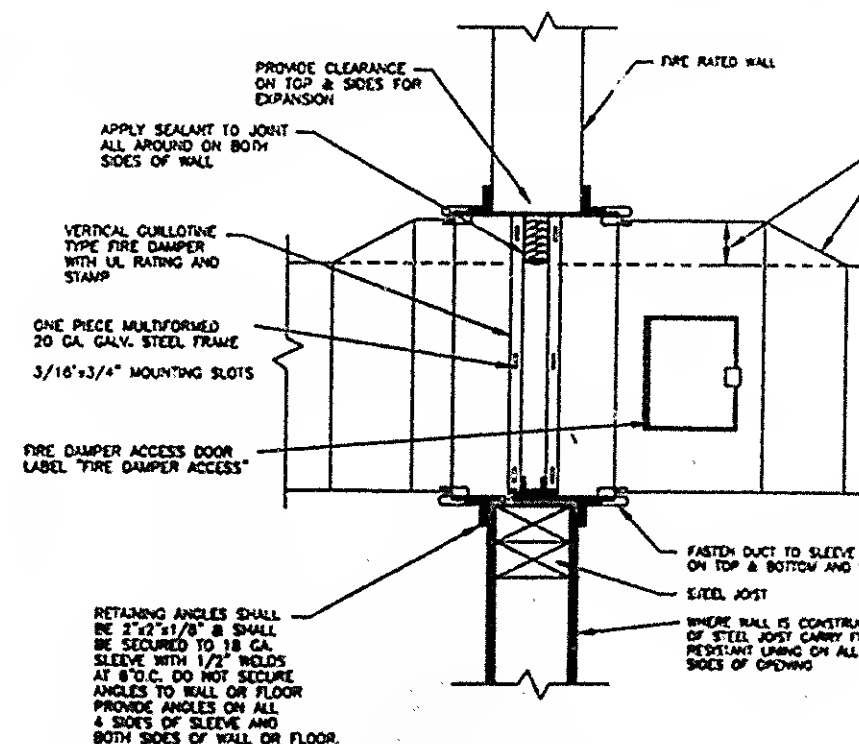

SECTION THRU FIRE DAMPER AT FIRE RATED WALL